


Product	Length	Product	Length	Product	Length
1 1/2" T&F Rim Board	24'	1 1/2" TimberStrand® LSL	24'	2x4	24'
16d (0.135" x 3")	10	6d (0.131" x 2 1/2")	10	16d (0.131" x 3")	10
1 1/2" T&F Rim Board	24'	1 1/2" TimberStrand® LSL	24'	2x4	24'
16d (0.135" x 3")	10	6d (0.131" x 2 1/2")	10	16d (0.131" x 3")	10

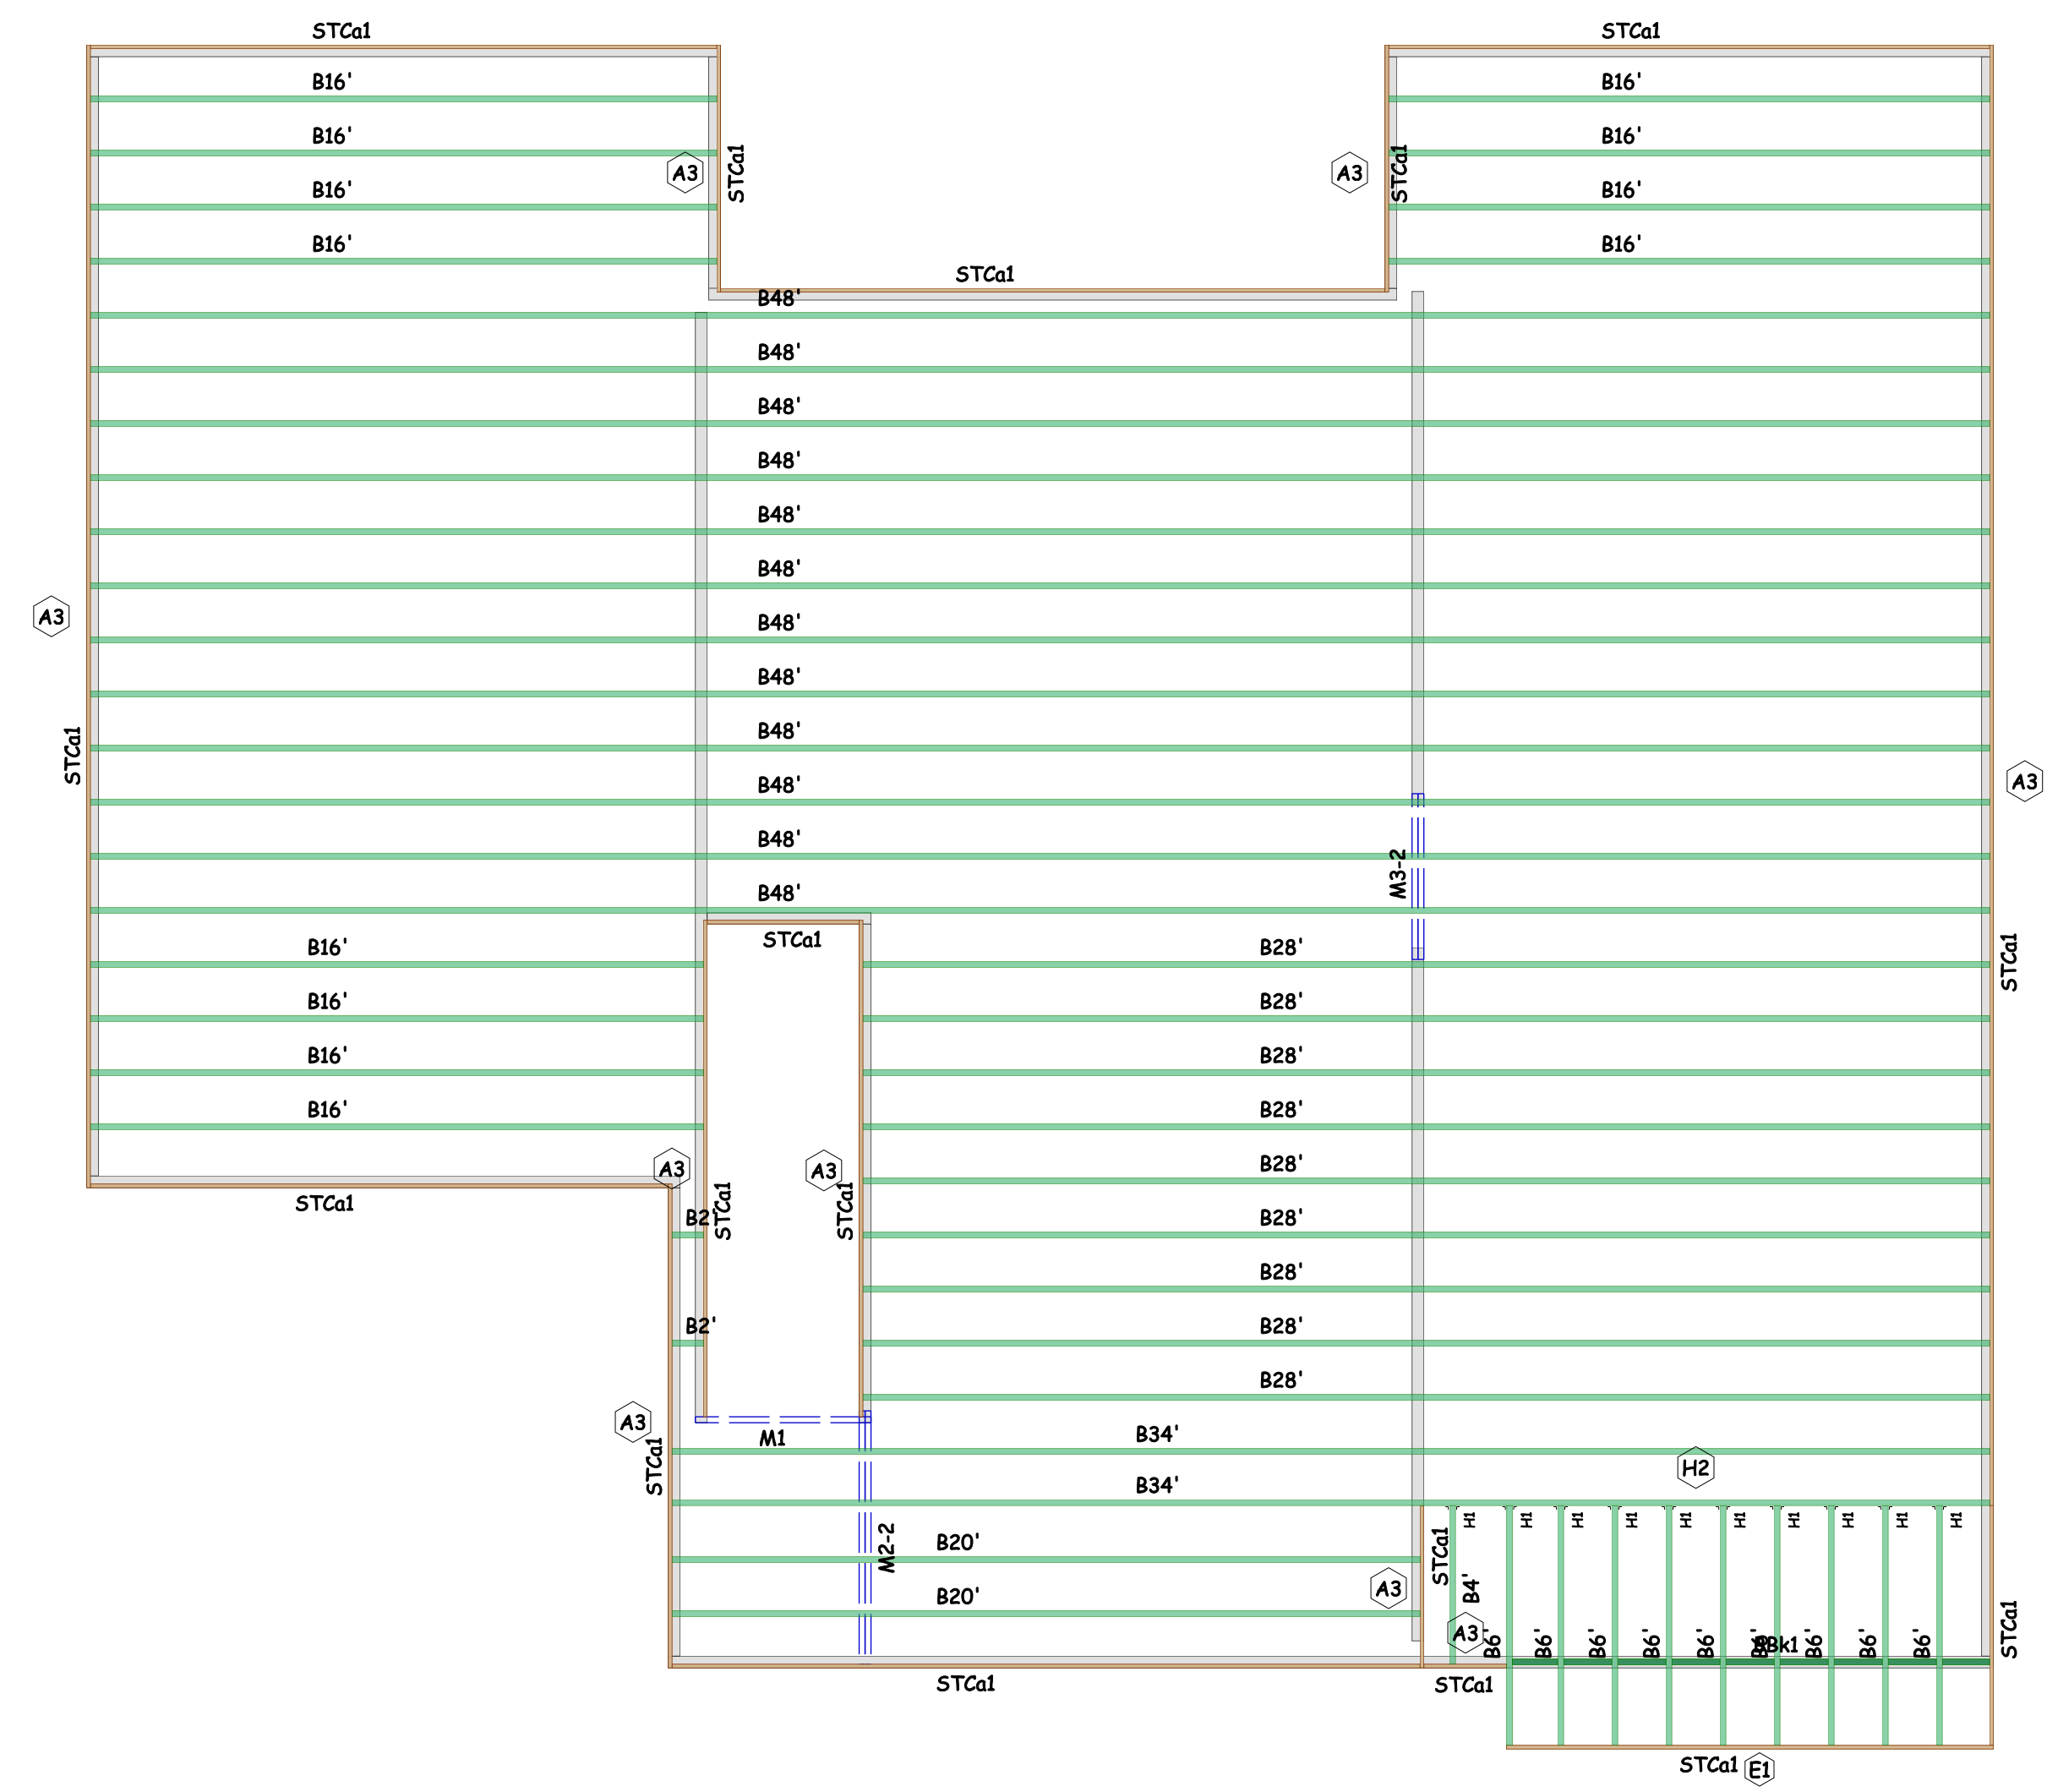

LEVEL NOTES	
Current Date:	5/19/2019
File Name:	VANTAGE POINT Park Place D488L2.jvl
Level Name:	Foundation
TJ-Pro Rating (Weighted Average):	43
Minimum Level TJ - Pro Rating & Joist:	TJ-Pro rating = 36, joist = B48' (344)
Maximum Level TJ - Pro Rating & Joist:	TJ-Pro rating = 51, joist = B28' (348)
Building Code - Design Methodology:	IBC 2015
FLOOR	
Floor Container:	FC9, FC7
Use/Occupancy:	ResidentialLivingAreas
Floor Area Loading is:	40.0 lb/ft² Live Load & 12.0 lb/ft² Dead Load
Maximum Allowed Deflection:	L/480 Live Load & L/240 Total Load
TJ-Pro Rating Information:	
Weighted Average:	FC9: 43
Directly Applied Ceiling:	None
Decking Attachment:	Glue and Nail
Decking Material:	23/32"x48"x96" Weyerhaeuser Edge Panel (0/24) T&G FF
Perpendicular Partition:	No
Strapping at max 8' o.c.:	None
Blocking at max 8' o.c.:	No
Poured Flooring:	No

Products				
PlotID	Length	Product	Plies	Net Qty
B48'	48' 0"	11 7/8" TJ® 110	1	12
B34'	34' 0"	11 7/8" TJ® 110	1	2
B28'	28' 0"	11 7/8" TJ® 110	1	9
B20'	20' 0"	11 7/8" TJ® 110	1	2
B16'	16' 0"	11 7/8" TJ® 110	1	12
B6'	6' 0"	11 7/8" TJ® 110	1	9
B4'	4' 0"	11 7/8" TJ® 110	1	1
B2'	2' 0"	11 7/8" TJ® 110	1	2
M1	6' 0"	1 3/4" x 11 7/8" 2.0E Microllam® LVL	1	1
M2-2	8' 0"	1 3/4" x 9 1/2" 2.0E Microllam® LVL	2	2
M3-2	6' 0"	1 3/4" x 9 1/2" 2.0E Microllam® LVL	2	2
STCa1	24' 0"	1 1/8" x 11 7/8" TJ® Rim Board	1	10

Accessories				
PlotID	Length	Product	Plies	Net Qty
1' 0"	5/8" or 3/4"	Backer Blocks	1	20
9 1/8"	5/8" x 2 5/16"	Web Stiffeners	1	2
		23/32"x48"x96" Weyerhaeuser Edge Panel (0/24) T&G FF	1	52

Blocking				
PlotID	Length	Product	Plies	Net Qty
BBk1	2' 0"	11 7/8" TJ® 110	1	9

Framing Connector Summary												
PlotID	Qty	Manuf	Product	Design Method	Face Nails	Top Nails	Member Nails	Skew	Slope	Backer Blks	Filler	Web Stiff
HI	10	Simpson	ITTS1.81/11.88	Undesigned	2-10d x 1-1/2	4-10d x 1-1/2	-	-	-	2	No	No

**WARNING**

Joists are unstable until braced laterally.  
Bracing includes:

- Blocking
- Bracing
- Shear Walls
- Shear Plates
- Shear Keys
- Shear Studs



**WARNING NOTES:**

- 1. Lack of proper bracing during construction can result in serious accidents. Observe the following guidelines:
- 2. Properly install all blocking, hangers, rim boards, and toe nails at 12" spaced intervals.
- 3. Install a permanent brace (sheathing, bracing or tie) in the end joints of the end of the bay or around end wall.
- 4. Safety bracing of 1x4 (minimum) must be nailed to a braced end wall or sheathed area end to each joint.
- 5. Sheathing (or equivalent) must be 1/2" thick for the full length of the bay to be braced.
- 6. Ends of cantilevers require safety bracing on both the top and bottom flanges.
- 7. The design must create a rigid frame.

Weyerhaeuser, Microllam, Framlam, TimberStrand, T&F, and Trus Joist are registered trademarks of Weyerhaeuser NR. © 2014 Weyerhaeuser NR Company. All rights reserved.

These placement plans have been developed for the specification of products based on project information provided. This service is solely intended for product application assurance and is not intended to circumvent the need for a design professional as determined by the building code. The designer of record and/or builder/framer is responsible to assure these drawings are compatible with the overall project.

Prepared By:

Address/Lot:  
City, State:  
Job #:  
Scale:

Customer:  
Job Name:  
Plan/Model #:  
Subdivision:

Symbol Legend	
◇	User Defined Point Load
○	User Defined Line Load
□	User Defined Area Load
BBk	Beams By Others
PKO	Post By Others
→	Layout Start Location
○	Construction Detail Callout (See Framers' Pocket Guide)
○	Excessive Point Load (WARNING: Member design did not include this load. Special consideration is required by the designer of record.)
○	Required Bracing Length (Only placed at insufficient bracing locations.)